

Roof Curb Specification / Structural Skylight Curb

SECTION 07721 PREFABRICATED HVAC STRUCTURAL ROOF CURBS

PART 1 - GENERAL

1.01 SUMMARY

- A. The General Contractor shall provide all labor, material and equipment to completely install the Prefabricated HVAC Roof Curbs.

1.03 INSTALLATION

- A. The Prefabricated HVAC Roof Curbs must be installed in accordance with instructions and as detailed on drawings.
- B. Stack roof curbs at site to prevent twisting, bending, or permanent deformation.

1.05 COORDINATION

- A. The Prefabricated HVAC Roof Curb sizes and options must be coordinated by AES Industries and the General and/or Mechanical Contractor prior to fabrication.
- B. Shop drawing approval required prior to fabrication.

PART 2 - PRODUCTS

2.01 SUMMARY

- A. Subject to compliance with requirements, provide Prefabricated HVAC Roof Curbs as manufactured by the following:

1. Model ASRC by **AES Industries, Inc., Tallassee, Alabama 36078, exclusively through Logistics Lighting with an extended warranty and National Account pricing. Contact for quotes or product questions: Sales@LogisticsLighting.com or 307-633-9696 or Toll-Free at 844-455-7283 website: www.LogisticsLighting.com**

2.03 FABRICATION

A. Structural Skylight Curbs: Coated 14 gauge steel sheet curb sections, corners mitered or enclosed and fully welded; 2 inch by 4 inch (nominal dimension) pressure treated continuous wood nailers mechanically fastened with corrosion resistant fasteners at 12 inches on center to exterior face of curb. Shop prime welded connections with zinc-rich paint complying with SSPC-Paint 20.

B. Web Height: Comply with local code requirements for minimum curb height, but in no case shall curb height be less than 18 inches, as measured from top of bar joist to top of curb, nor shall curb height be less than 8 inches as measured from top of roof membrane to top of curb.

C. Profile: Bottom Flange, Top Flange, and Drip: As shown.

D. Internal Support Frame (Safety Screen): Provide 14 gauge, 3/4"x 3/4" maximum galvanized steel support angle to interior perimeter walls of curb, recessed from top flange 3/4" minimum. Internal support frame for safety screen to be welded to curb at 6" on center with minimum 1" welds. Support frame may be roll formed into the curb wall for a maximum 3/4"x 3/4" surface area for grid attachment .

E. Safety Screen: Shop fabricated 3/16 inch cold rolled galvanized steel rods welded in 6 inch by 6 inch grid pattern. Screen to be welded to the internal support frame at each grid point (min. 6" on center). Safety screen shall not be mounted on top of curb, or attached to curb wall without the internal support frame. For venting skylights when used, allow room at top inside face of curb for smoke vent installation. Internal support frame and Screen shall have been tested to withstand impact of 245 pound lead weight, 10-3/4 inch diameter, dropped from height of 3 feet and support concentrated load of 600 pounds after impact.

F. Shop Painting: Shop finish interior surfaces of curbs, including safety screen; PPG-6-157 dry fog coating as specified; color to match Sherwin-Williams #SW2537 "Blossom White".

Structural Roof Curbs / Skylights


Customer _____ Project _____
 Ship To _____ Architect _____
 _____ Engineer _____
 P.O. Number _____ Approved By _____

Model **ASRC**

Structural curb for insulated roof decks.
 No steel framing required. P.E. certified
 test data available.

Standard Construction


14 Ga. Galvanized Steel Construction
 Full Height Welded Corners
 Factory installed 2x4 Pressure Treated
 Wood Nailer
 14" Min. Height
 No Sub-framing Required
 6"x6" Security/Safety Grid Installed

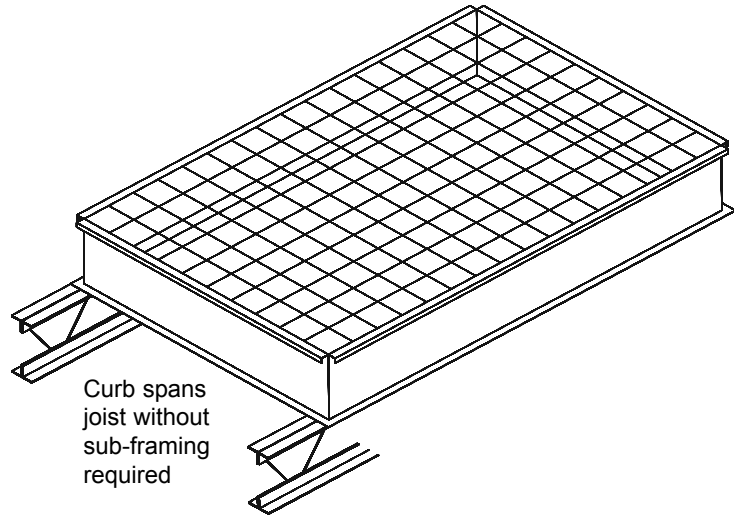

Optional Construction

- ☐ 1/2" Burglar Bars
☐ Height or Slope as required

check all that apply

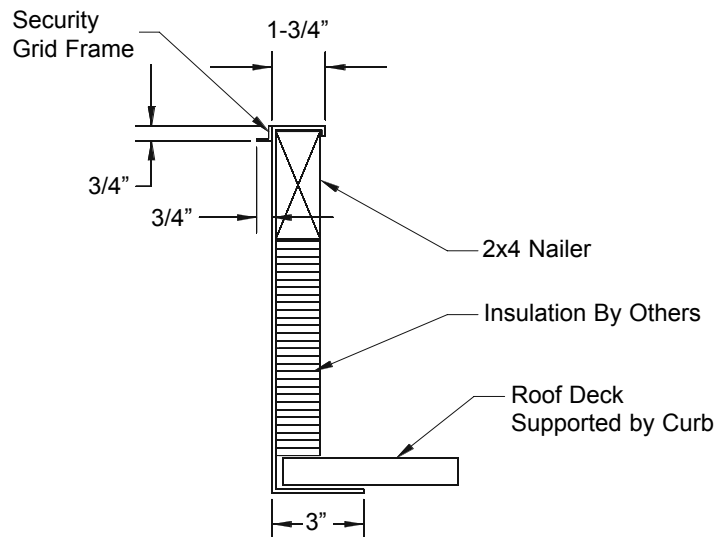

TYPICAL SECTION

QTY	Skylight Model/Size (OD)	COMMENTS