

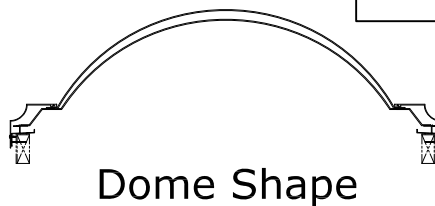


CURB MOUNTED SHRINK OUT SMOKE VENT CSOS

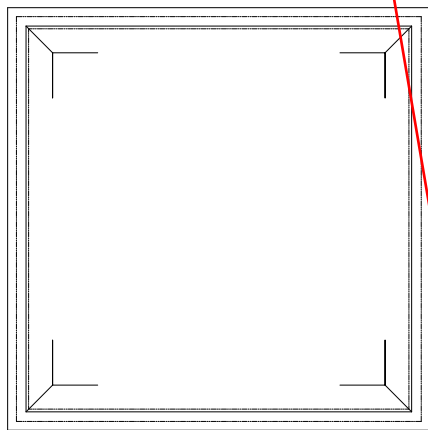

CAUTION: WHEN INSTALLING THIS PRODUCT THE AREA BELOW THE UNIT MUST BE CLEAR OF OBSTRUCTIONS WHICH COULD IMPEDE THE RELEASE OF THE DOMES

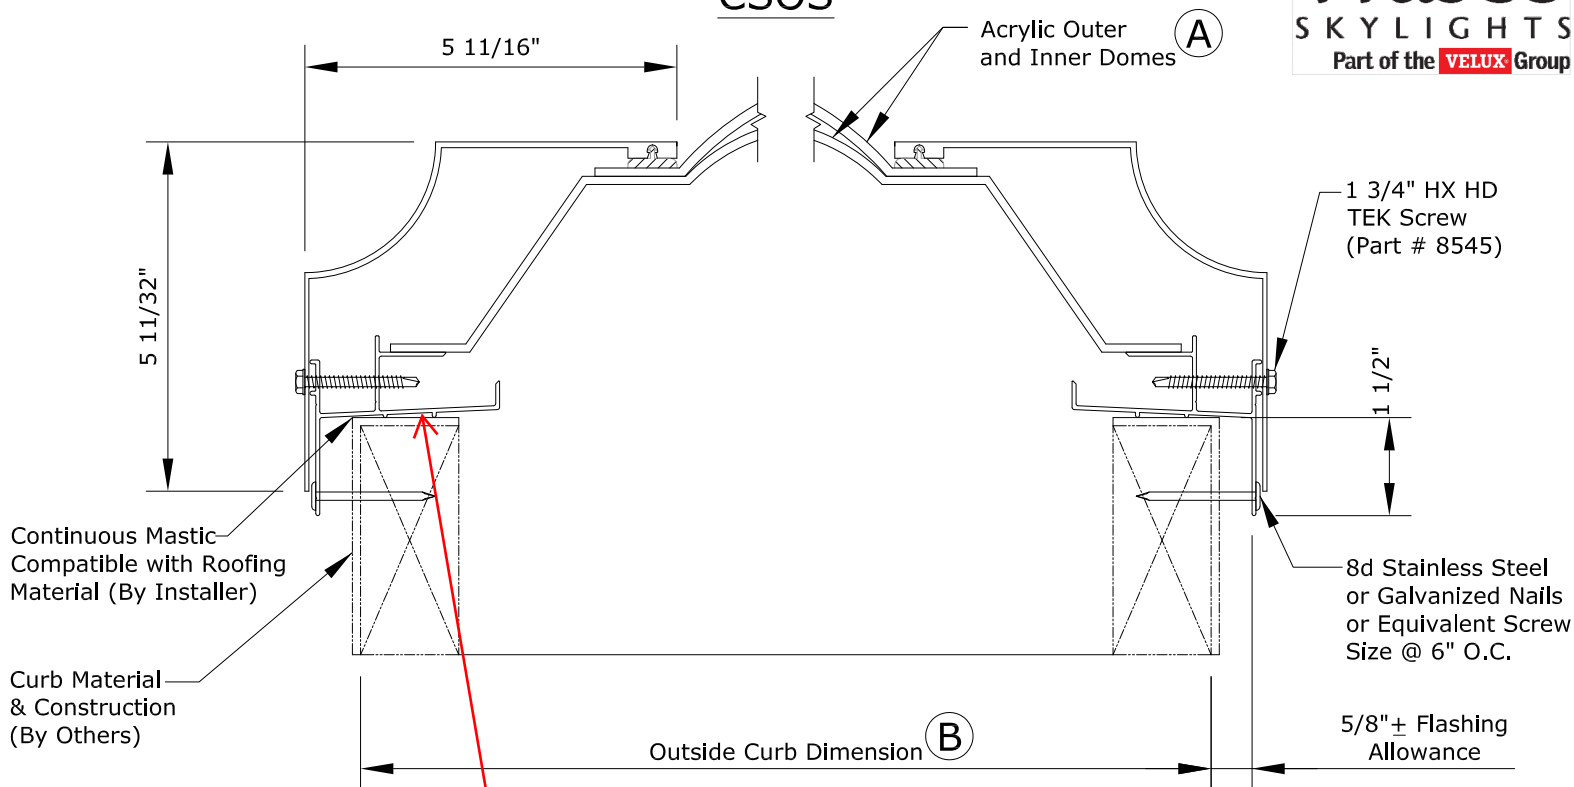

Automatically Operated Roof Vent
4LM7 ROOF CLASS 90
Installed on a Minimum 9" High Curb
UL Listed Units are designed to operate in a fire per the UL-793 Fire Exposure Test.

Skylight Details & Measurements

- Ⓐ Glazing: Clear acrylic over white IMA
- Ⓑ OCD: 51 in. x 75 in.

Material # CSOS_4872_7A1S2



Please review and then sign and date this page indicating your approval that the details are accurate and you would like to proceed with this order. Once received, the product(s) will be scheduled for production. All orders are non-cancelable, non-refundable and non-returnable.

LL#:
QTY:

APPROVED BY: _____

DATE: _____

NOTE: This shrink-out vent requires curb sealant or gasket installed in the field (not included). See installation guide for details.